

Report No.:

Test Time: 2025-09-28 15:44

## Luminaire Property

Luminaire Manufacturer:

Luminaire Description: 24D

Luminous Width (mm): -45

Current: 0.112 A

Power Factor: 0.540

Luminous Length (mm): -45

Voltage: 225.0 V

Power: 13.60 W

## Photometric Results

CIE Class: Direct

Measurement Flux: 1455.5 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H34.6

Vertical Diffuse Angle(50%): V34.6

Luminaire Efficacy Rating (LER): 107.07

Max. Intensity: 4065.93 cd

S/MH(C0/C180): 0.58

Total Rated Lamp Lumens: 1455.5 lm

Efficiency: 100%

Upward Ratio: 0%

Central Intensity: 3996.29 cd


Pos of Max. Intensity: H0 V3

S/MH(C90/C270): 0.58

Picture Of Luminaire



Luminous Intensity Distribution Curve

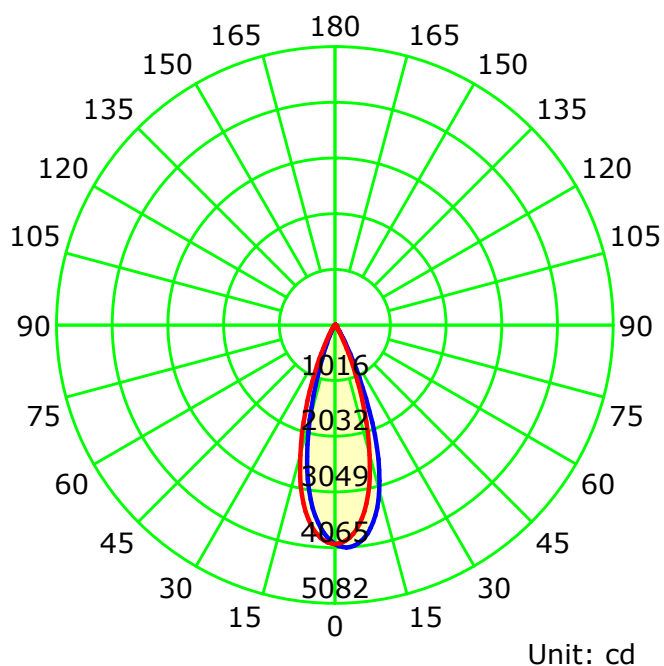

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:


## Luminous Intensity Distribution Curve

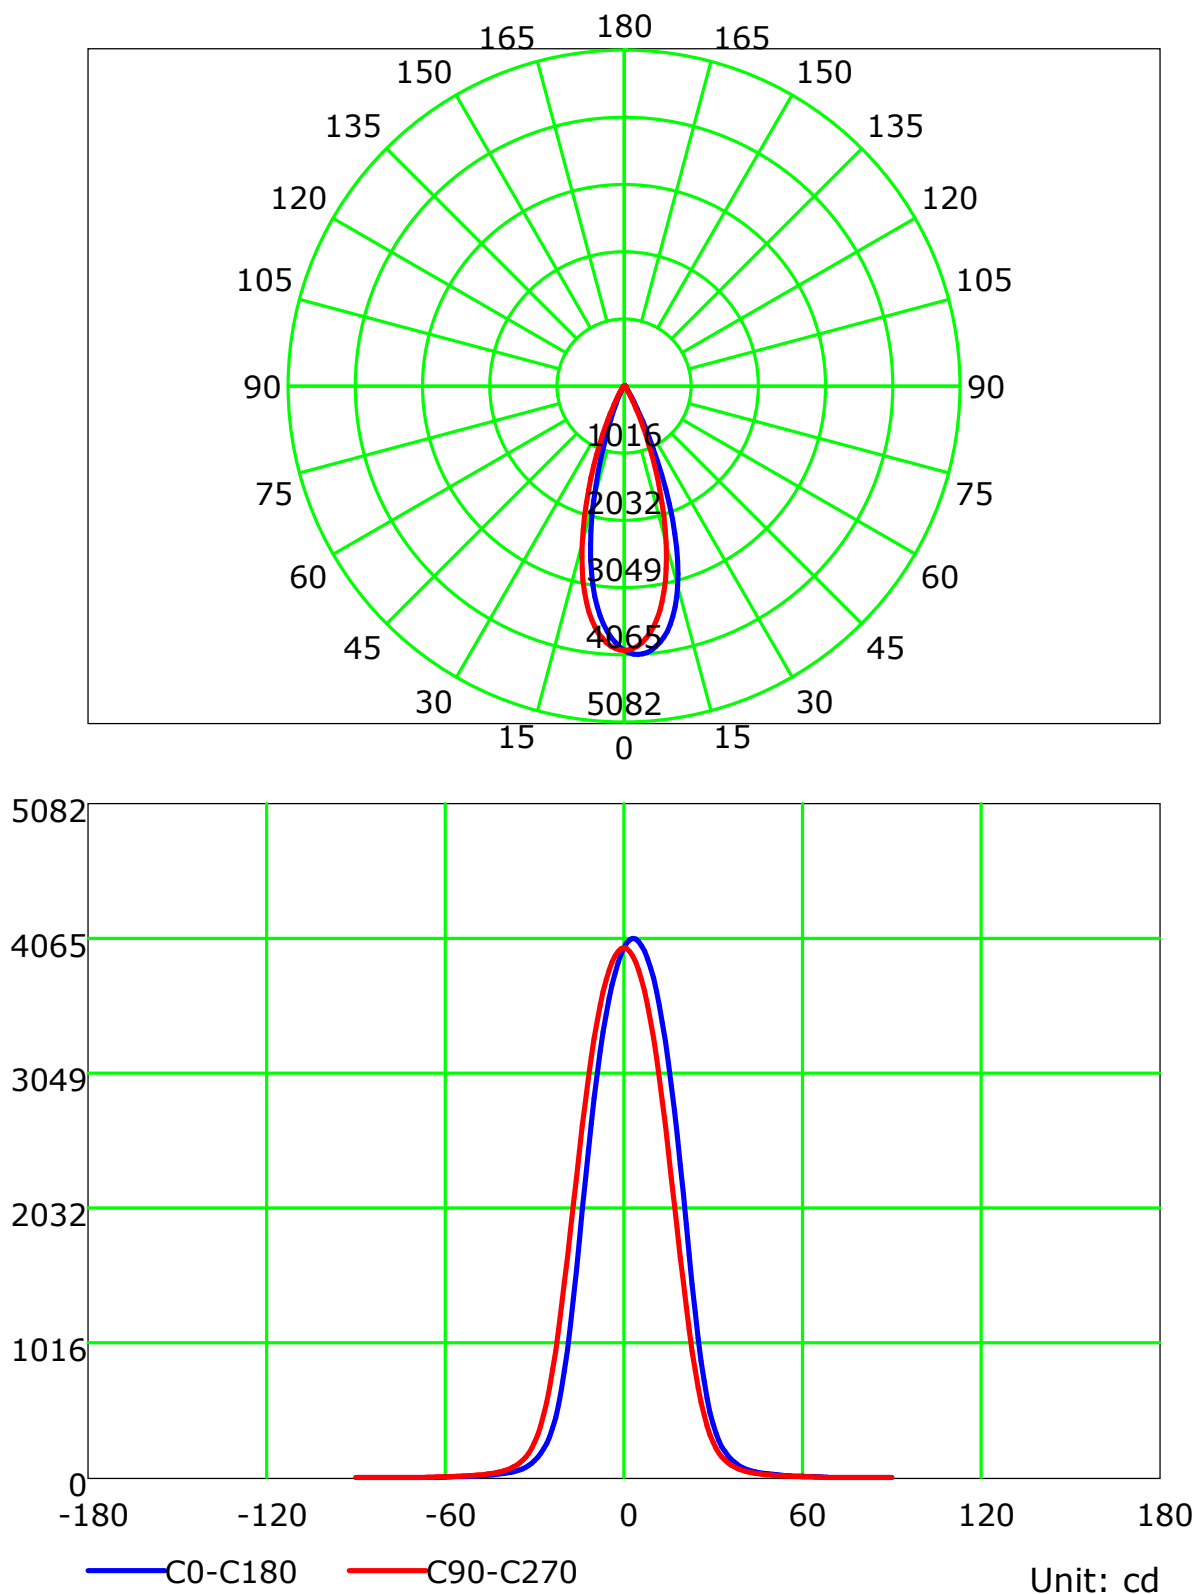

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:


## Luminous Intensity Distribution Curve(cd/klm)

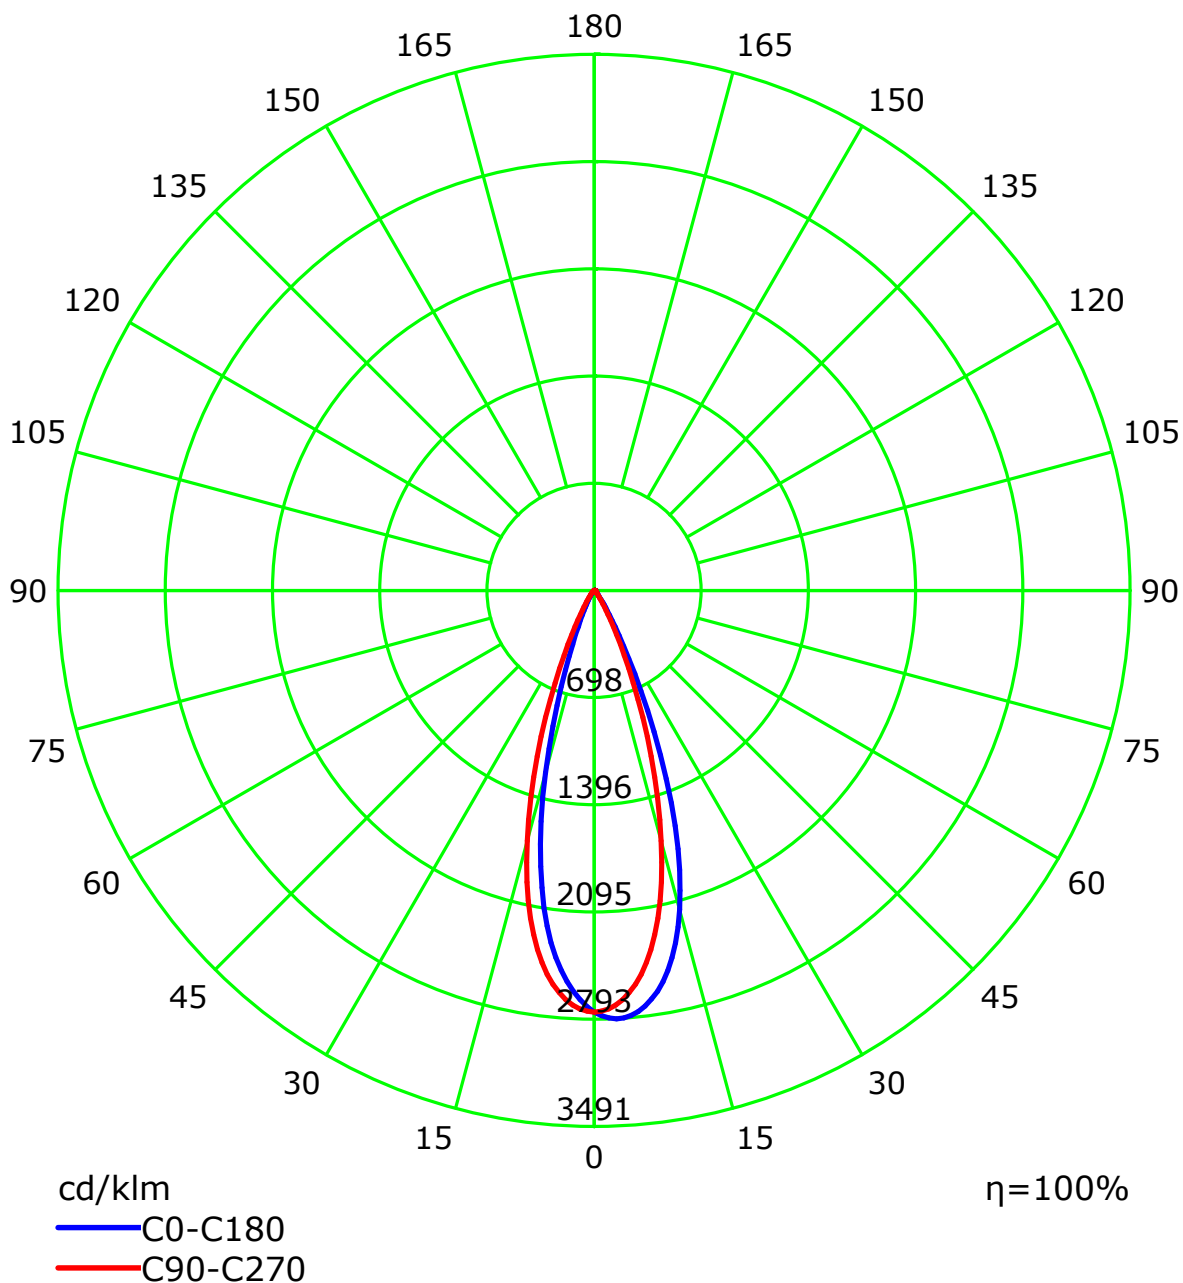

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Isocandela (rectangle)

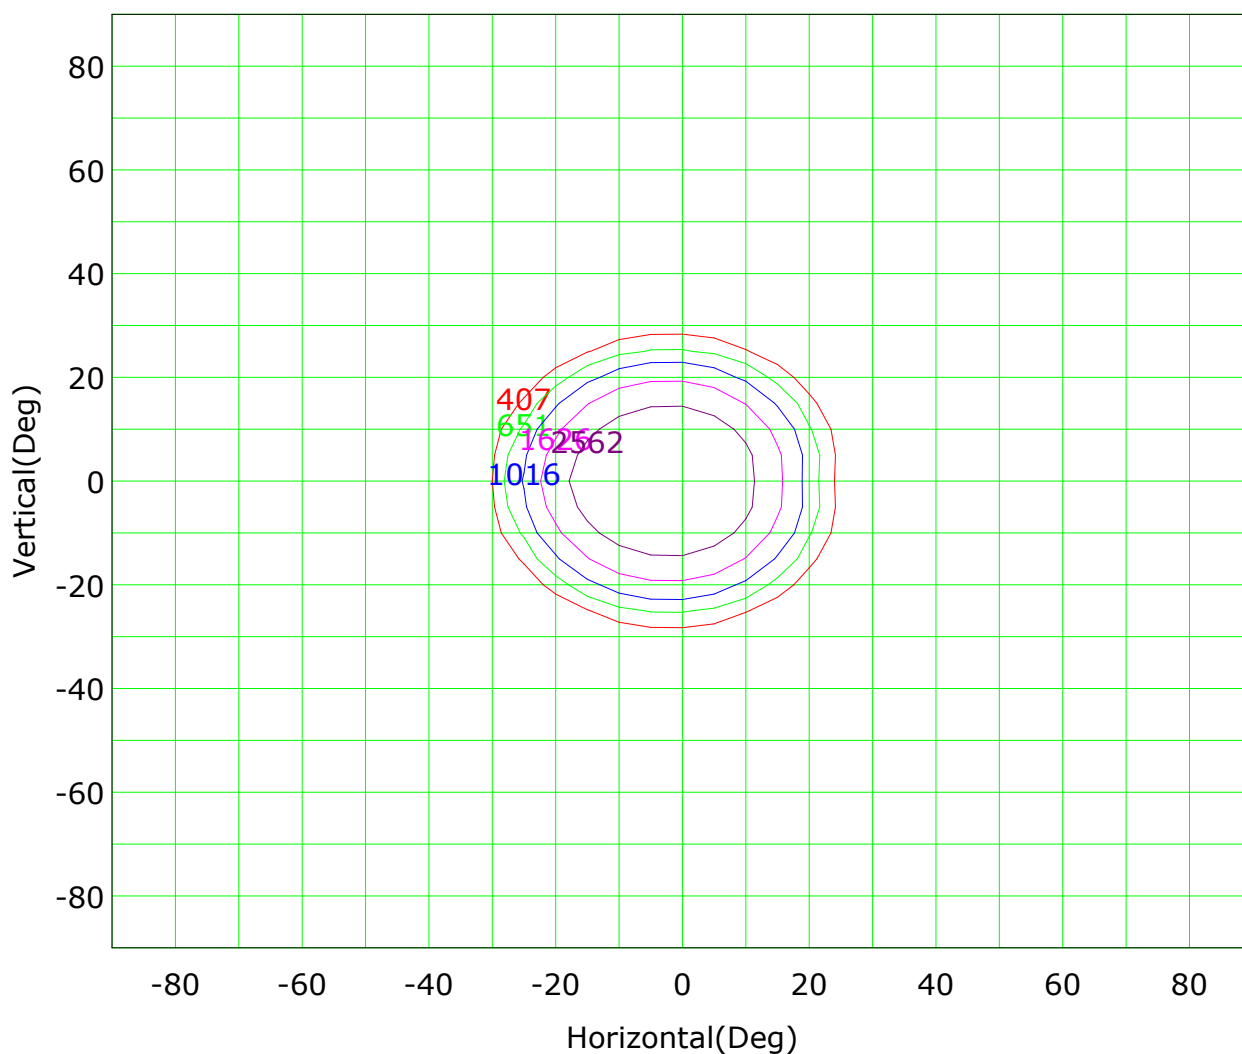

Imax (100%): 4066 cd

( 10%): 407 cd	( 16%): 651 cd
( 25%): 1016 cd	( 40%): 1626 cd
( 63%): 2562 cd	(100%): 4066 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 2.905 m

Humidity:

Inspector:

## IsoLux Plot

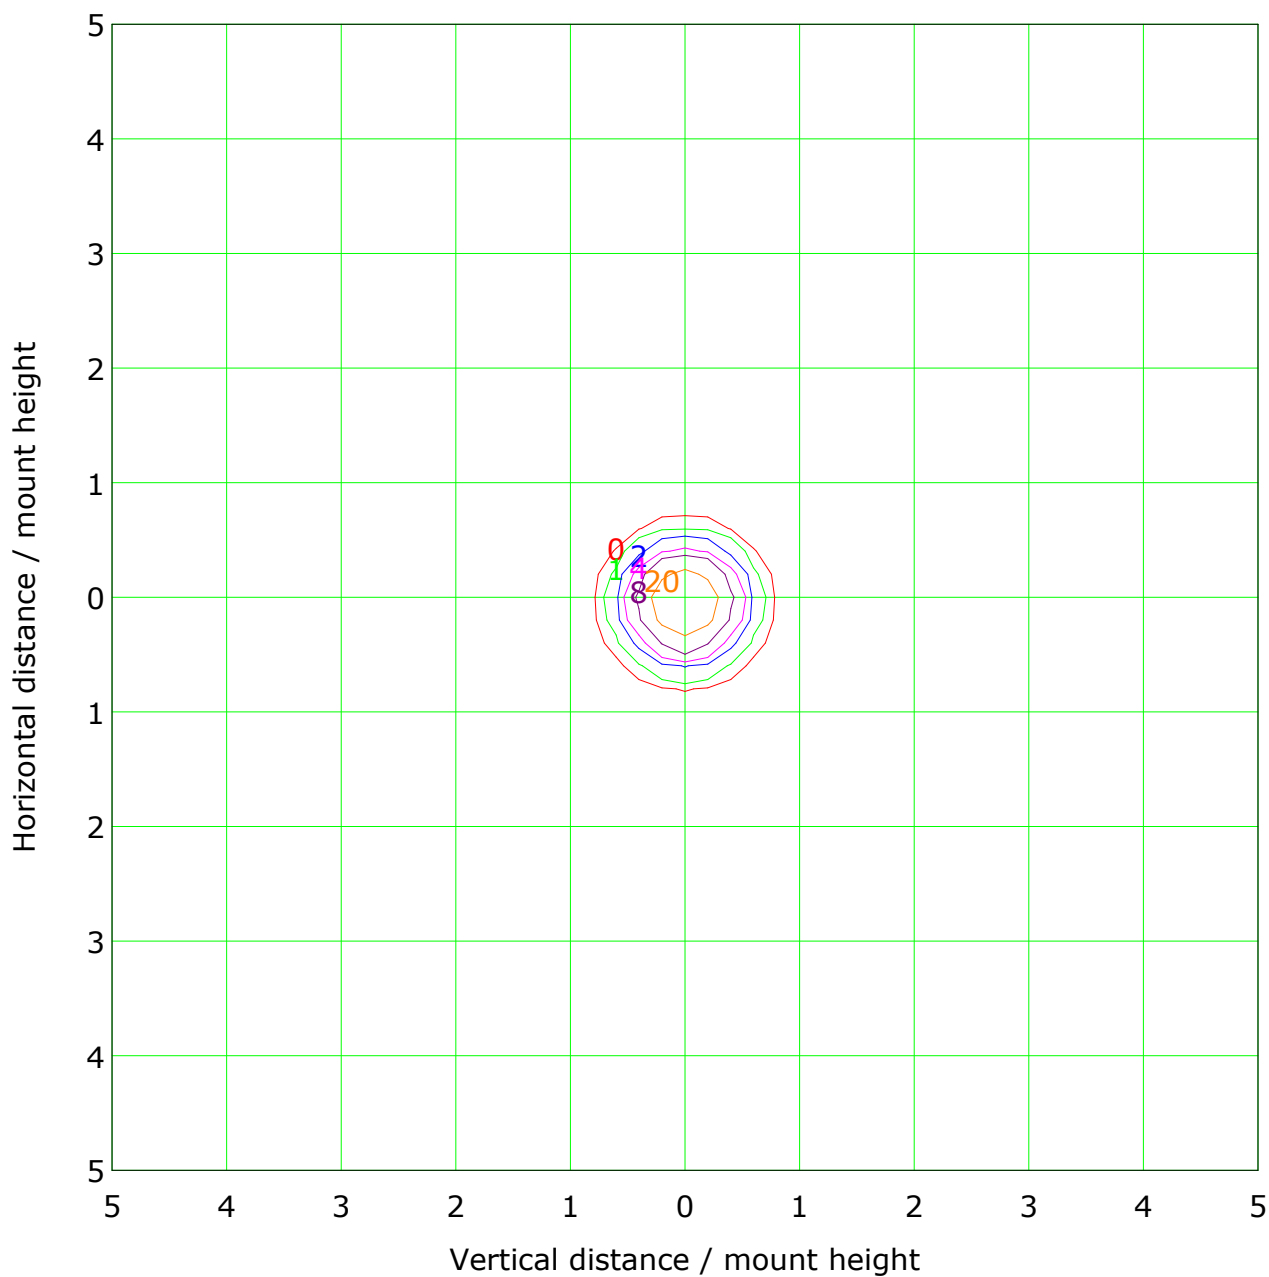


Mounting Height: 10.0m    Max Lux(100%): 40.5 lx

( 1%): 0.4 lx	( 2%): 0.8 lx
( 5%): 2.0 lx	( 10%): 4.0 lx
( 20%): 8.1 lx	( 50%): 20.2 lx
(100%): 40.5 lx	


C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Illuminance at a Distance

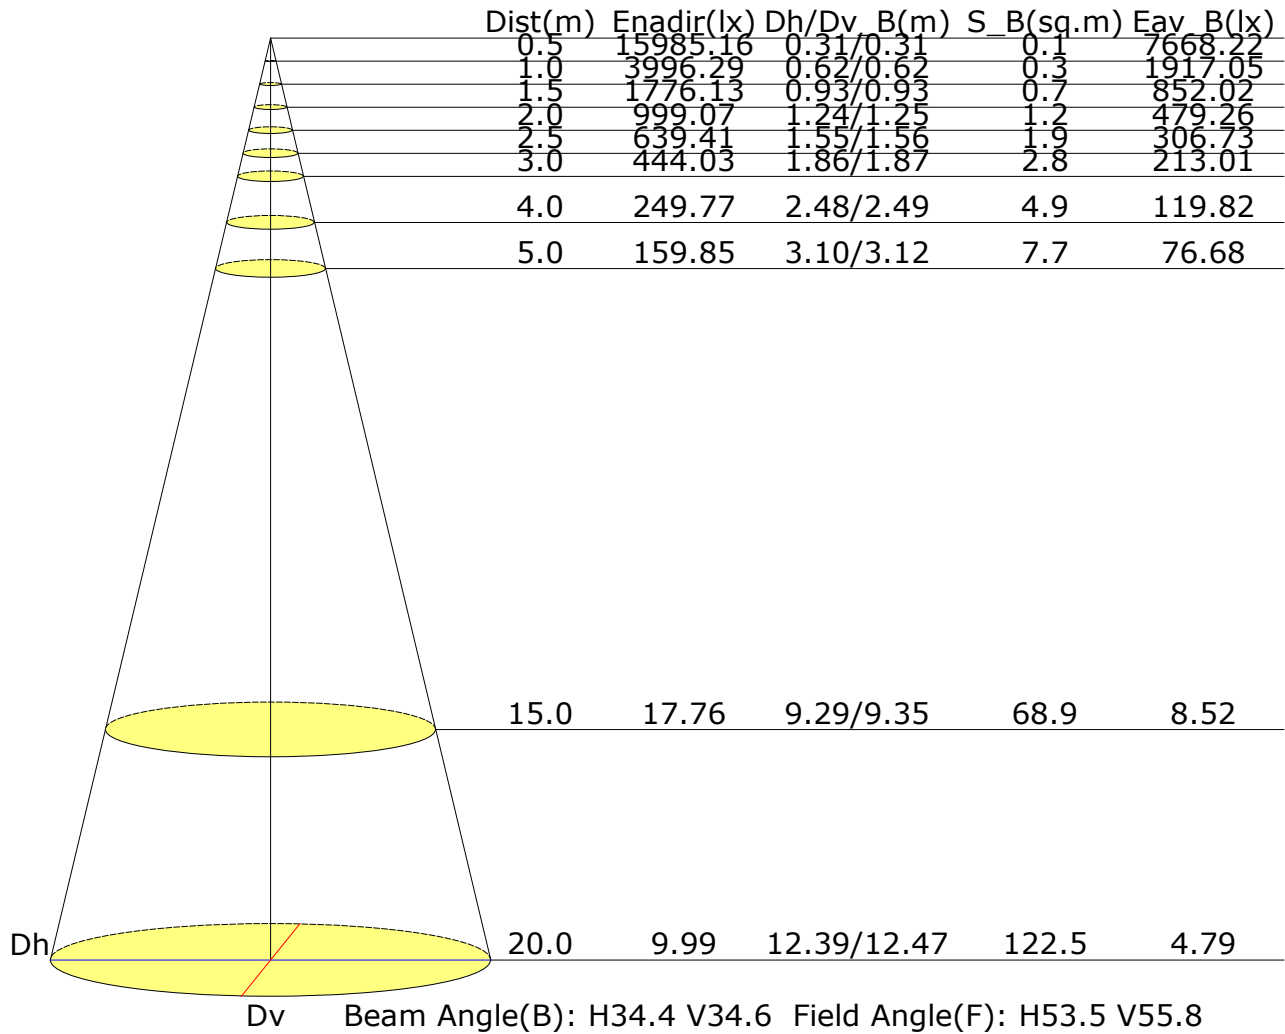

## Vertical IsoLux Plot

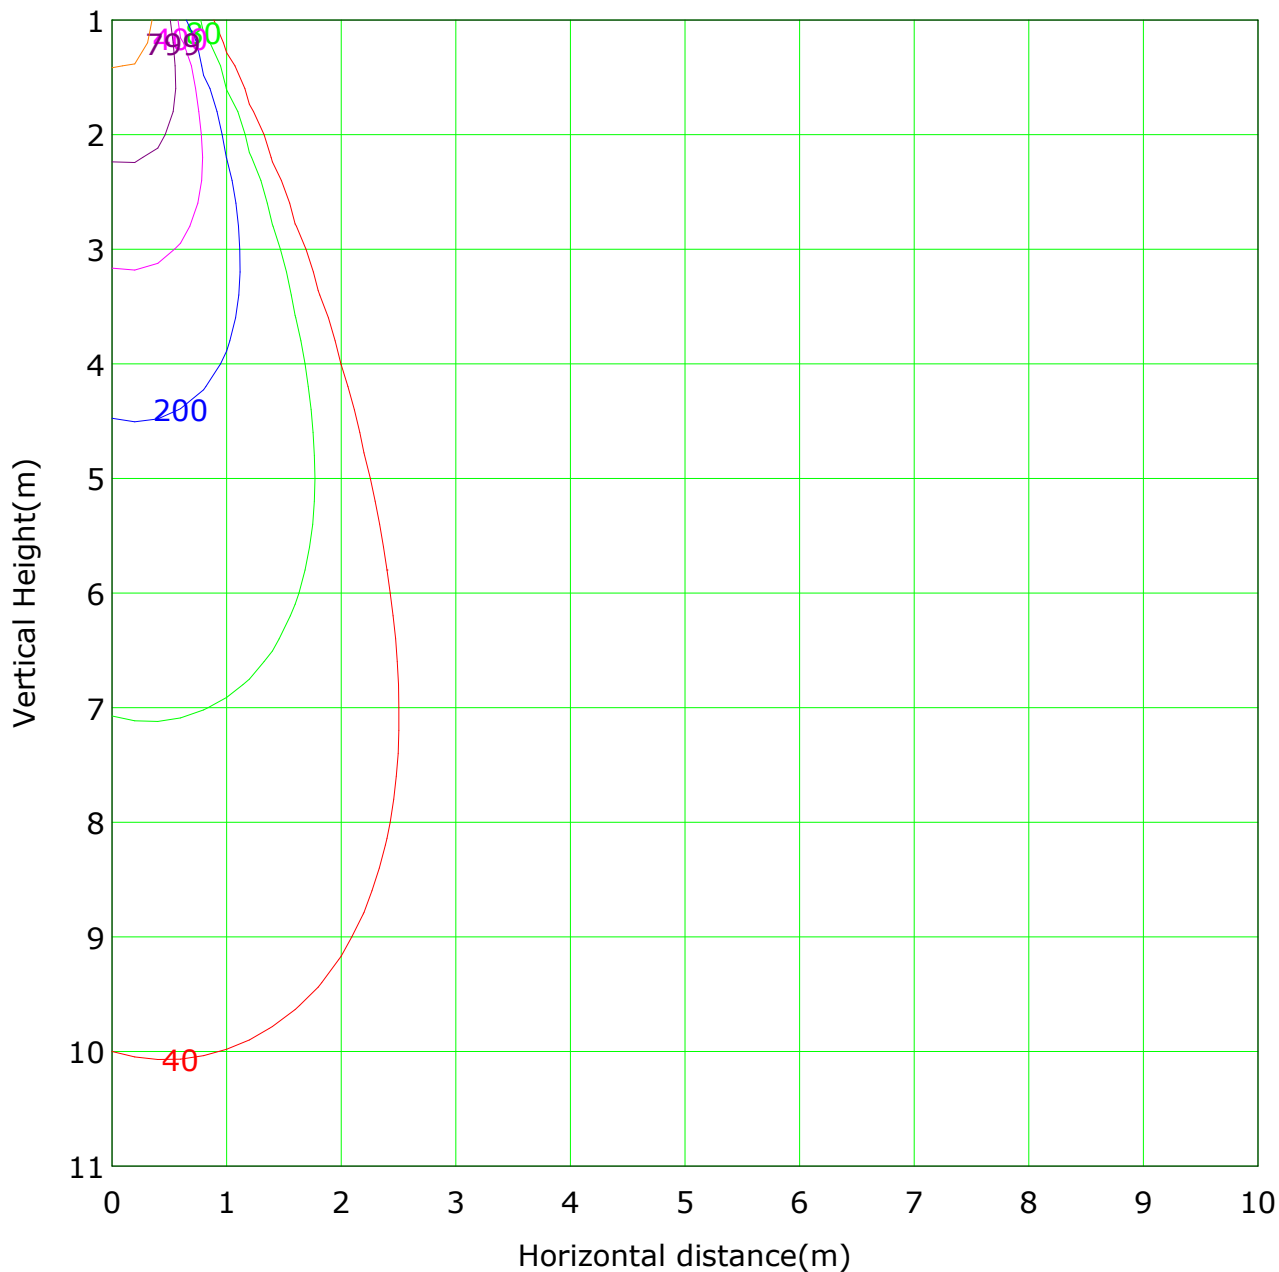

Lowest(m): 1.0m   Highest(m): 11.0m   Max Lux: 3996.3 lx  
— ( 1%): 40.0 lx   — ( 2%): 79.9 lx  
— ( 5%): 199.8 lx   — ( 10%): 399.6 lx  
— ( 20%): 799.3 lx   — ( 50%): 1998.1 lx  
— (100%): 3996.3 lx


C Plane (°): 0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°): 0.0-90.0: 1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:



## The Average Illuminance Effective Figure

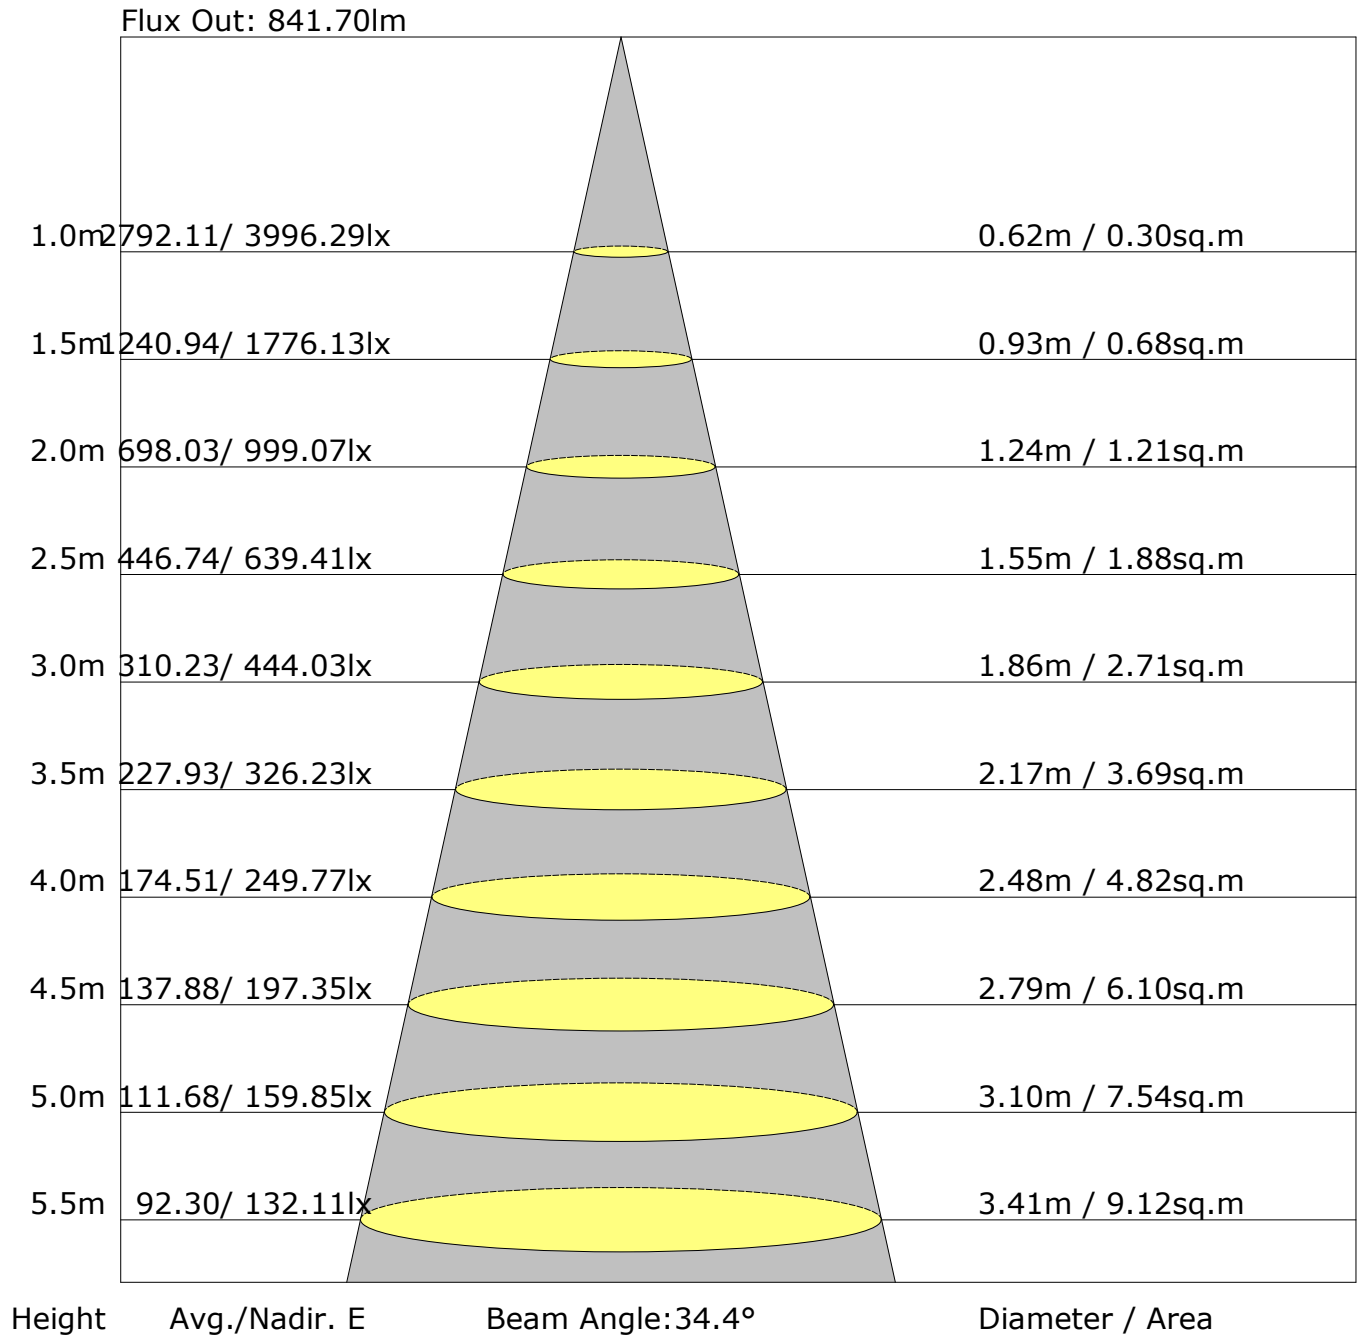

## UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	17.4	18.0	17.6	18.2	18.4	15.8	16.5	16.1	16.7	16.9
3H	17.3	17.9	17.6	18.1	18.4	15.7	16.3	16.0	16.6	16.8
4H	17.2	17.8	17.5	18.1	18.3	15.6	16.2	15.9	16.5	16.7
6H	17.1	17.7	17.5	18.0	18.2	15.6	16.1	15.9	16.4	16.7
8H	17.1	17.6	17.4	17.9	18.2	15.5	16.0	15.9	16.3	16.6
12H	17.1	17.6	17.4	17.9	18.2	15.5	16.0	15.8	16.3	16.6
X=4H Y=2H	17.2	17.8	17.5	18.1	18.3	15.7	16.3	16.0	16.6	16.8
3H	17.2	17.7	17.5	18.0	18.3	15.6	16.1	16.0	16.4	16.7
4H	17.1	17.5	17.4	17.8	18.2	15.5	16.0	15.9	16.3	16.7
6H	17.0	17.4	17.4	17.7	18.1	15.5	15.9	15.9	16.2	16.6
8H	16.9	17.3	17.4	17.7	18.1	15.4	15.8	15.8	16.2	16.6
12H	16.9	17.2	17.3	17.6	18.0	15.4	15.7	15.8	16.1	16.5
X=8H Y=4H	16.9	17.3	17.4	17.7	18.1	15.4	15.8	15.8	16.2	16.6
6H	16.8	17.1	17.3	17.6	18.0	15.3	15.6	15.8	16.0	16.5
8H	16.8	17.0	17.3	17.5	18.0	15.3	15.5	15.7	16.0	16.4
12H	16.7	17.0	17.2	17.4	17.9	15.2	15.4	15.7	15.9	16.4
X=12H Y=4H	16.9	17.2	17.3	17.6	18.0	15.4	15.7	15.8	16.1	16.5
6H	16.8	17.0	17.3	17.5	18.0	15.3	15.5	15.7	16.0	16.4
8H	16.7	17.0	17.2	17.4	17.9	15.2	15.4	15.7	15.9	16.4
Variations with the observer position at spacings:										
S=1.0H	+4.9/-5.5					+4.4/-5.3				
S=1.5H	+7.5/-6.5					+7.0/-7.7				
S=2.0H	+9.5/-13.9					+8.9/-14.8				

Calculate in accordance with CIE Pub.117. The table is revised with  $1455\text{lm}$  ( $8\log(F/F_0) = 1.3$ ).

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

**FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM**

	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	836	57.4
	FL ( 0°-30°)	765	52.6
	FM (30°-60°)	68	4.7
	FH (60°-80°)	2	0.2
	FVH (80°-90°)	0	0.0
	BACK LIGHT	620	42.6
	BL ( 0°-30°)	575	39.5
	BM (30°-60°)	44	3.0
	BH (60°-80°)	1	0.1
	BVH (80°-90°)	0	0.0
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U0 G0

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Zonal Lumen

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3992.8	3.8	3.8	0.26	0.26
1.0-2.0	3979.2	11.4	15.2	0.78	1.05
2.0-3.0	3952.6	18.9	34.2	1.30	2.35
3.0-4.0	3912.6	26.2	60.3	1.80	4.15
4.0-5.0	3858.8	33.2	93.5	2.28	6.43
5.0-6.0	3791.8	39.9	133.4	2.74	9.17
6.0-7.0	3710.7	46.1	179.5	3.16	12.33
7.0-8.0	3614.9	51.7	231.2	3.56	15.89
8.0-9.0	3505.2	56.8	288.0	3.90	19.79
9.0-10.0	3380.6	61.2	349.2	4.20	23.99
10.0-11.0	3240.9	64.8	414.0	4.45	28.44
11.0-12.0	3088.2	67.5	481.5	4.64	33.08
12.0-13.0	2923.0	69.4	550.9	4.77	37.85
13.0-14.0	2746.4	70.3	621.2	4.83	42.68
14.0-15.0	2557.4	70.2	691.4	4.82	47.50
15.0-16.0	2359.8	69.2	760.5	4.75	52.25
16.0-17.0	2159.6	67.3	827.8	4.62	56.88
17.0-18.0	1960.5	64.6	892.5	4.44	61.32
18.0-19.0	1762.4	61.3	953.8	4.21	65.53
19.0-20.0	1568.1	57.4	1011.2	3.94	69.48
20.0-21.0	1381.5	53.1	1064.2	3.65	73.12
21.0-22.0	1202.9	48.3	1112.6	3.32	76.44
22.0-23.0	1034.9	43.4	1156.0	2.98	79.43
23.0-24.0	881.8	38.6	1194.6	2.65	82.08
24.0-25.0	745.4	33.9	1228.5	2.33	84.40
25.0-26.0	624.9	29.5	1258.0	2.03	86.43
26.0-27.0	520.8	25.5	1283.5	1.75	88.18
27.0-28.0	431.6	21.9	1305.3	1.50	89.68
28.0-29.0	356.1	18.6	1323.9	1.28	90.96
29.0-30.0	293.8	15.9	1339.8	1.09	92.05
30.0-31.0	243.5	13.6	1353.4	0.93	92.99
31.0-32.0	202.9	11.6	1365.0	0.80	93.78
32.0-33.0	169.9	10.0	1375.0	0.69	94.47
33.0-34.0	143.4	8.7	1383.7	0.60	95.07
34.0-35.0	121.9	7.6	1391.2	0.52	95.59
35.0-36.0	104.2	6.6	1397.9	0.46	96.04

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Zonal Lumen (Continue 1)

Gamma [°]	I <sub>mean</sub> [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	89.7	5.8	1403.7	0.40	96.45
37.0-38.0	77.3	5.2	1408.9	0.35	96.80
38.0-39.0	66.7	4.6	1413.4	0.31	97.11
39.0-40.0	57.5	4.0	1417.5	0.28	97.39
40.0-41.0	50.1	3.6	1421.0	0.24	97.63
41.0-42.0	44.1	3.2	1424.2	0.22	97.85
42.0-43.0	39.1	2.9	1427.1	0.20	98.05
43.0-44.0	34.9	2.6	1429.8	0.18	98.23
44.0-45.0	31.2	2.4	1432.2	0.16	98.40
45.0-46.0	28.1	2.2	1434.4	0.15	98.55
46.0-47.0	25.4	2.0	1436.4	0.14	98.69
47.0-48.0	22.9	1.8	1438.2	0.13	98.82
48.0-49.0	20.6	1.7	1439.9	0.12	98.93
49.0-50.0	18.6	1.6	1441.5	0.11	99.04
50.0-51.0	16.9	1.4	1442.9	0.10	99.14
51.0-52.0	15.4	1.3	1444.2	0.09	99.23
52.0-53.0	14.1	1.2	1445.5	0.08	99.31
53.0-54.0	13.0	1.1	1446.6	0.08	99.39
54.0-55.0	12.0	1.1	1447.7	0.07	99.46
55.0-56.0	10.8	1.0	1448.6	0.07	99.53
56.0-57.0	9.9	0.9	1449.5	0.06	99.59
57.0-58.0	9.2	0.8	1450.4	0.06	99.65
58.0-59.0	8.4	0.8	1451.2	0.05	99.71
59.0-60.0	7.6	0.7	1451.9	0.05	99.76
60.0-61.0	6.7	0.6	1452.5	0.04	99.80
61.0-62.0	5.9	0.6	1453.1	0.04	99.84
62.0-63.0	5.2	0.5	1453.6	0.03	99.87
63.0-64.0	4.6	0.5	1454.1	0.03	99.90
64.0-65.0	4.0	0.4	1454.5	0.03	99.93
65.0-66.0	3.2	0.3	1454.8	0.02	99.95
66.0-67.0	2.4	0.2	1455.0	0.02	99.97
67.0-68.0	1.7	0.2	1455.2	0.01	99.98
68.0-69.0	1.0	0.1	1455.3	0.01	99.99
69.0-70.0	0.7	0.1	1455.4	0.00	99.99
70.0-71.0	0.5	0.0	1455.4	0.00	100.00
71.0-72.0	0.2	0.0	1455.4	0.00	100.00

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3996.3	3996.3								
G1.0	4032.6	3946.1								
G2.0	4055.6	3882.6								
G3.0	4065.9	3806.4								
G4.0	4061.2	3716.9								
G5.0	4042.7	3614.5								
G6.0	4012.5	3497.3								
G7.0	3969.6	3363.2								
G8.0	3912.7	3214.0								
G9.0	3846.6	3047.4								
G10.0	3766.8	2861.4								
G11.0	3669.9	2665.6								
G12.0	3558.1	2459.2								
G13.0	3428.6	2245.8								
G14.0	3289.2	2021.8								
G15.0	3130.2	1788.5								
G16.0	2958.2	1562.4								
G17.0	2771.8	1345.9								
G18.0	2576.8	1147.3								
G19.0	2361.8	963.8								
G20.0	2141.5	805.2								
G21.0	1911.9	667.3								
G22.0	1682.4	550.2								
G23.0	1456.5	450.7								
G24.0	1247.2	373.0								
G25.0	1052.6	308.9								
G26.0	879.6	258.3								
G27.0	728.0	217.2								
G28.0	598.3	182.8								
G29.0	489.2	154.0								
G30.0	402.8	129.2								
G31.0	333.5	108.5								
G32.0	277.3	92.0								
G33.0	231.7	78.6								
G34.0	195.8	67.6								
G35.0	165.6	58.6								
G36.0	141.0	51.7								

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:

## Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	120.1	45.9								
G38.0	102.2	41.0								
G39.0	86.6	36.9								
G40.0	73.8	32.9								
G41.0	63.8	29.8								
G42.0	55.9	26.9								
G43.0	49.4	24.3								
G44.0	44.2	21.7								
G45.0	39.6	19.4								
G46.0	35.9	17.5								
G47.0	32.6	15.7								
G48.0	29.5	13.7								
G49.0	27.0	12.2								
G50.0	24.5	10.9								
G51.0	22.4	9.8								
G52.0	20.1	9.4								
G53.0	18.0	8.9								
G54.0	16.4	8.7								
G55.0	14.5	8.3								
G56.0	12.7	7.8								
G57.0	11.6	7.3								
G58.0	11.1	6.7								
G59.0	10.2	5.7								
G60.0	9.8	4.6								
G61.0	9.1	3.4								
G62.0	8.9	2.1								
G63.0	8.4	1.4								
G64.0	7.7	1.0								
G65.0	6.7	0.4								
G66.0	5.4	0.1								
G67.0	4.2	0.0								
G68.0	2.5	0.0								
G69.0	1.5	0.0								
G70.0	1.1	0.0								
G71.0	0.7	0.0								
G72.0	0.1	0.0								
G73.0	0.1	0.0								

C Plane (°):0.0-180.0: 180.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-90.0:1.0  
Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector:



Unit: cd

[illegible]

Test Device: CHL-6E  
Distance: 2.905 m  
Humidity:  
Inspector: